

NORCO COLLEGE

Safety Assessment
October 26, 2018





1. Repair/Replace non functioning
Automatic/Power assisted door.
ADAAG 404.3.5



2. Remove accumulated waste materials. Provide process to control and maintain vegetation clearance requirements. CCR, Title 19. Section 304





3. Maintain minimum 36-inch clearance in front of all electrical panels. NEC 110-26(A)(1). Repair damaged Electrical equipment.




4. Organize/remove excess storage - potential trip hazards as well as excess combustibles.





5. Remove excess storage from around compactor equipment. Area should be clear to prevent trips and falls.

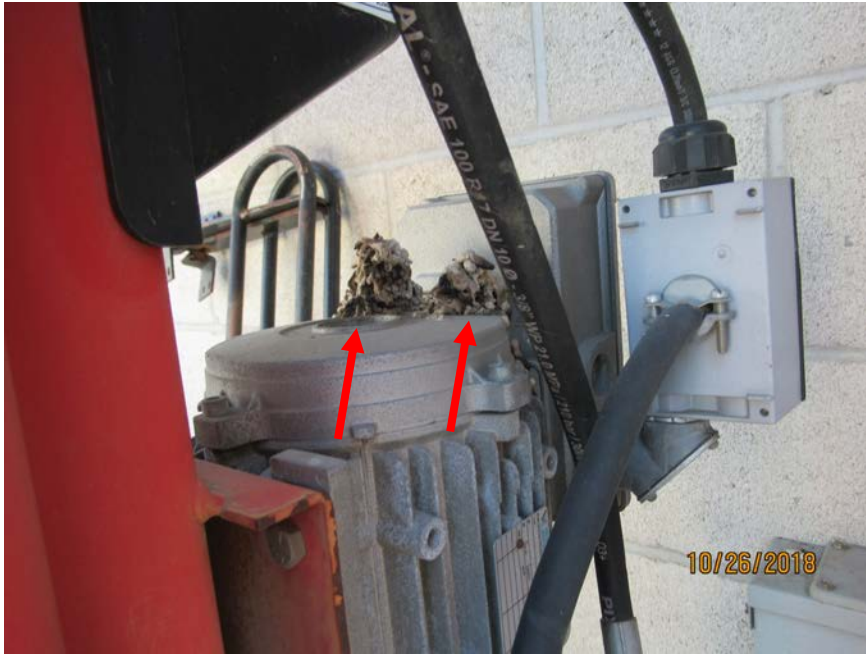

6. Remove acidic bird droppings to prevent damage to industrial machinery. Not only is the equipment being damaged, but workers are exposed to a dangerous health-risk any time they work on or around the machinery.



7. Equipment not in use should be de-energized to prevent damage/injury accidental start-up.



9. Remove storage from on/around microwave ovens.



8. Organize and secure items stored overhead to prevent from falling. Organize storage. Potential trip hazard as well as excess combustibles.


Permanent aisles, ladders, stairways, and walkways shall be kept reasonably clear and in good repair. CCR Title 8, 3272(c)



10. Remove storage from on/around Thermostats.



11. Provide regular maintenance inspections according to guidelines in water intrusion plans . Inspect/repair water lines for loose hardware or leaks.

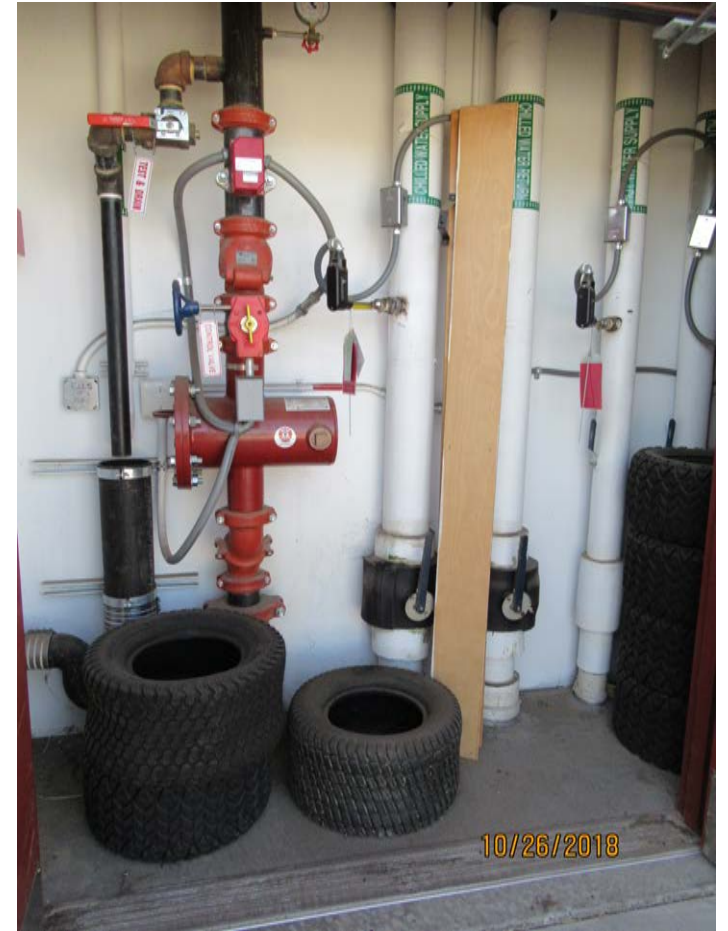

12. Remove storage from Fire Riser Room. IFC 901.4.6, IFC 509.2



13. Secure ladders to prevent from falling. CCR. Title 8, 2940.6(d)



14. Label all secondary chemical containers. CCR. Title 8, 5194(f)(6)



16. Eyewash stations shall be maintained and free of items which obstruct their use. CCR. Title 8, 5162(c)

Store all flammables chemicals in flammables storage cabinet with secondary containment. Title 8, 5164(a)



17. Stop and emergency stop pushbuttons shall be continuously operable and readily accessible. NFPA 79, 10.7.1

15. Appliances shall be connected directly to permanently installed receptacle. CFC 605.4-5





18. Facilities shall be provided for protecting charging apparatus from damage by mobile equipment. Mobile equipment shall be properly positioned and brake applied before attempting to change or charge batteries. CCR Title 8, 5185(i)





19. Permits are required for air tanks over 125 gallons. Permit exceptions depend on vessel capacity and operating pressures. The permit shall be posted under glass in a conspicuous place on or near the air tank or in a weatherproof container secured to the unit, and shall be available at all times to any qualified inspector. CCR Title 8, 461(c)




20. Secure ladders to prevent from falling. CCR. Title 8, 2940.6(d). Permanent aisles, ladders, stairways, and walkways shall be kept reasonably clear and in good repair. Where, due to lack of proper definition, such aisles or walkways become hazardous, they shall be clearly defined by painted lines, curbing, or other method of marking. CCR Title 8, 3272(c)



21. Exits shall be maintained free of all obstructions or impediments to full instant use in the case of fire or other emergency. CCR Title 8, 3225(1)



23. Maintain minimum 36-inch clearance in front of all electrical panels. NEC 110-26(A)(1).

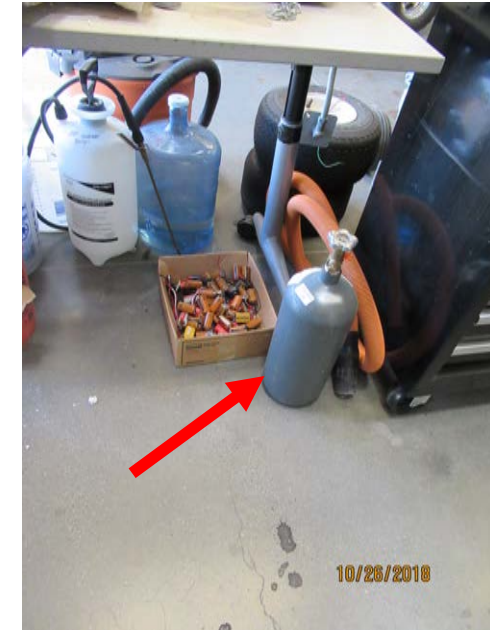

24. Compressed gas cylinders shall be stored or transported in a manner to prevent them from creating a hazard by tipping, falling or rolling. CCR Title 8, 4650(e)



22. Secure ladders to prevent from falling. CCR. Title 8, 2940.6(d). Permanent aisles, ladders, stairways, and walkways shall be kept reasonably clear and in good repair. Where, due to lack of proper definition, such aisles or walkways become hazardous, they shall be clearly defined by painted lines, curbing, or other method of marking. CCR Title 8, 3272(c)

25. The employer shall provide portable fire extinguishers and shall mount, locate and identify them so that they are readily accessible to employees without subjecting the employees to possible injury. CCR Title 8, 6151(c)(1)





26. The rated capacity of all industrial lift trucks and industrial tractors shall be displayed at all times on the vehicle in such a manner that it is readily visible to the operator. CCR Title 8, 3660(a). Must include attachments that will affect load center of gravity.




27. Secure ladders to prevent from falling. CCR. Title 8, 2940.6(d)(D)



28. Remove flexible power cords used in place of permanent wiring. as a substitute for the fixed wiring of a structure. CCR Title 8, 2500(a)(1)

Bundle and constrain cords and cables under/around workstations.

Eliminate use of piggy-backed power strips and extension cords. NFPA Section 11.1.4

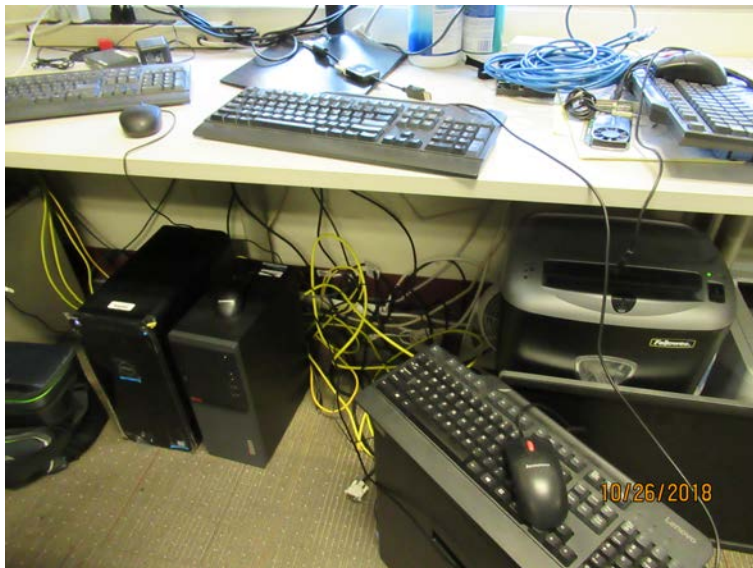



29. Organize and secure items stored overhead to prevent from falling. Organize storage. Potential trip hazard as well as excess combustibles.

Permanent aisles, ladders, stairways, and walkways shall be kept reasonably clear and in good repair. CCR Title 8, 3272(c)

Riverside Community College District

Safety Survey Recommendations – Status Report

Norco College

CSRM Safety Survey Date: October 26, 2018

ITEM	ROOM	RECOMMENDATION	STATUS (i.e. completed, in process)	ANTICIPATED COMPLETION DATE
1	Operations Center	Repair/Replace nonfunctioning Automatic/Power assisted door. ADAAG 404.3.5		
2	Operations Center	Remove accumulated waste materials. Provide process to control and maintain vegetation clearance requirements. CCR, Title 19. Section 304		
3	Operations Center	Maintain minimum 36-inch clearance in front of all electrical panels. NEC 110-26(A)(1). Repair damaged Electrical equipment.		
4	Operations Center	Organize/remove excess storage - potential trip hazards as well as excess combustibles.		
5	Operations Center	Remove excess storage from around compactor equipment. Area should be clear to prevent trips and falls.		
6	Operations Center	Remove acidic bird droppings to prevent damage to industrial machinery. Not only is the equipment being damaged, but workers are exposed to a dangerous health-risk any time they work on or around the machinery.		
7	Operations Center	Equipment not in use should be de-energized to prevent damage/injury accidental start-up.		
8	Operations Center 157	Organize and secure items stored overhead to prevent from falling. Organize storage. Potential trip hazard as well as excess combustibles. Permanent aisles, ladders, stairways, and walkways shall be kept reasonably clear and in good repair. CCR Title 8, 3272(c)		
9	Operations Center	Remove storage from on/around microwave ovens.		
10	Operations Center	Remove storage from on/around Thermostats.		
11	Operations Center	Provide regular maintenance inspections according to guidelines in water intrusion plans. Inspect/repair water lines for loose hardware or leaks.		
12	Operations Center	Remove storage from Fire Riser Room. IFC 901.4.6, IFC 509.2		
13	Operations Center	Secure ladders to prevent from falling. CCR. Title 8, 2940.6(d)		
14	Operations Center	Label all secondary chemical containers. CCR. Title 8, 5194(f)(6)		
15	Operations Center	Appliances shall be connected directly to permanently installed receptacle. CFC 605.4-5		
16	Operations Center	Eyewash stations shall be maintained and free of items which obstruct their use. CCR. Title 8, 5162(c). Store all flammables chemicals in flammables storage cabinet with secondary containment. Title 8, 5164(a)		
17	Operations Center	Stop and emergency stop pushbuttons shall be continuously operable and readily accessible. NFPA 79, 10.7.1		
18	Operations Center	Facilities shall be provided for protecting charging apparatus from damage by mobile equipment. Mobile equipment shall be properly		

		positioned, and brake applied before attempting to change or charge batteries. CCR Title 8, 5185(i)		
19	Operations Center	Permits are required for air tanks over 125 gallons. Permit exceptions depend on vessel capacity and operating pressures. The permit shall be posted under glass in a conspicuous place on or near the air tank or in a weatherproof container secured to the unit and shall be available at all times to any qualified inspector. CCR Title 8, 461(c)		
20	Operations Center	Secure ladders to prevent from falling. CCR. Title 8, 2940.6(d). Permanent aisles, ladders, stairways, and walkways shall be kept reasonably clear and in good repair. Where, due to lack of proper definition, such aisles or walkways become hazardous, they shall be clearly defined by painted lines, curbing, or other method of marking. CCR Title 8, 3272(c)		
21	Operations Center	Exits shall be maintained free of all obstructions or impediments to full instant use in the case of fire or other emergency. CCR Title 8, 3225(1)		
22	Operations Center	Secure ladders to prevent from falling. CCR. Title 8, 2940.6(d). Permanent aisles, ladders, stairways, and walkways shall be kept reasonably clear and in good repair. Where, due to lack of proper definition, such aisles or walkways become hazardous, they shall be clearly defined by painted lines, curbing, or other method of marking. CCR Title 8, 3272(c)		
23	Operations Center	Maintain minimum 36-inch clearance in front of all electrical panels. NEC 110-26(A)(1).		
24	Operations Center	Compressed gas cylinders shall be stored or transported in a manner to prevent them from creating a hazard by tipping, falling or rolling. CCR Title 8, 4650(e)		
25	Operations Center	The employer shall provide portable fire extinguishers and shall mount, locate and identify them so that they are readily accessible to employees without subjecting the employees to possible injury. CCR Title 8, 6151(c)(1)		
26	Operations Center	The rated capacity of all industrial lift trucks and industrial tractors shall be displayed at all times on the vehicle in such a manner that it is readily visible to the operator. CCR Title 8, 3660(a). Must include attachments that will affect load center of gravity.		
27	Operations Center	Secure ladders to prevent from falling. CCR. Title 8, 2940.6(d)(D)		
28	Operations Center	Remove flexible power cords used in place of permanent wiring. as a substitute for the fixed wiring of a structure. CCR Title 8, 2500(a)(1). Bundle and constrain cords and cables under/around workstations. Eliminate use of piggy-backed power strips and extension cords. NFPA Section 11.1.4		
29	Operations Center	Organize and secure items stored overhead to prevent from falling. Organize storage. Potential trip hazard as well as excess combustibles. Permanent aisles, ladders, stairways, and walkways shall be kept reasonably clear and in good repair. CCR Title 8, 3272(c)		



Safety Assessment
November 9, 2018





2. Store all flammables chemicals in flammables storage cabinet with secondary containment. Title 8, 5164(a)

1. The employer shall provide portable fire extinguishers and shall mount, locate and identify them so that they are readily accessible to employees without subjecting the employees to possible injury. CCR Title 8, 6151(c)(1)

The employer shall assure that portable fire extinguishers are maintained in a fully charged and operable condition and kept in their designated places at all times except during use. CCR Title 8, 6151(c)(4)





3. Organize/remove excess storage - potential trip hazards as well as excess combustibles.

4. Exits shall be maintained free of all obstructions or impediments to full instant use in the case of fire or other emergency. CCR Title 8, 3225(1)



5. Provide proper storage procedures for hazardous waste/substances. CCR Title 8, 5164(a)(c)(d)





6. The minimum space required in toilet compartments is provided so that a person using a wheelchair can maneuver into position at the water closet. This space cannot be obstructed. 11B-604.8.1.1

7. Remove accumulated waste materials. Potential trip hazards as well as excess combustibles. Provide process to control and maintain vegetation clearance requirements. CCR, Title 19. Section 304



8. Eyewash and drench shower stations must be installed in a well-lit area and identified with a highly visible safety sign. ANSI Z358.1



9. Organize and secure shelves and items stored overhead to prevent from falling. Organize storage. Potential trip hazard as well as excess combustibles.



10. Machinery and equipment designed for a fixed location shall be restrained so as to prevent walking or moving from its location. CCR Title 8, 3328(d)

Secure ladders to prevent from falling. CCR. Title 8, 2940.6(d).



11. Remove storage from on/around microwave ovens.


12. Repair or secure opening to prevent the entrance or harborage of insects, rodents or other vermin. CCR Title 8, 3362(f)



13. Pesticides, emptied containers, or equipment that holds or has held a pesticide, shall not be stored, handled, emptied, disposed of, or left unattended in such a manner or at any place where they may present a hazard to persons, animals (including bees), food, feed, crops or property. CCR Title 3, 6670



14. Permanent aisles and walkways shall be kept reasonably clear and in good repair. CCR Title 8, 3272(c)

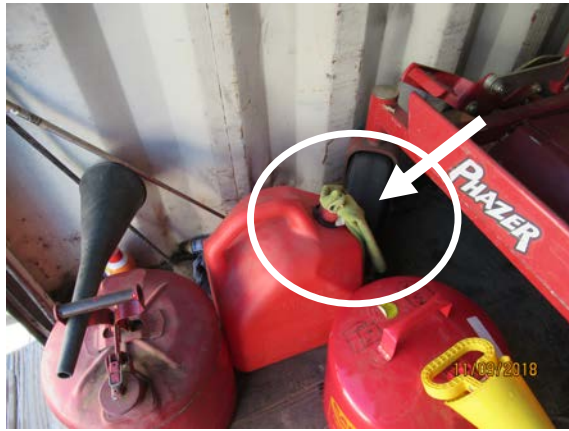

15. Store all flammables in flammables storage cabinet with secondary containment. Flammable or combustible liquids shall be stored in closed containers. CCR Title 8, 5545(a)



16. Trip, Fall hazard. Replace drain cover/grate.



17. Remove accumulated waste materials. Potential trip hazards as well as excess combustibles. Provide process to control and maintain vegetation clearance requirements. CCR, Title 19. Section 304





18. Provide emergency eyewash equipment. Eyewash must deliver 0.4 gallons of flushing fluid per minute for at least 15 minutes. ANSI Z358.1



19. Mount fire extinguisher to wall. CCR Title 8, 6151(c)(1)



20. Provide clearance around water heaters.



22. Organize and secure items stored overhead to prevent from falling. Organize storage. Potential trip hazard as well as excess combustibles.

Permanent aisles, ladders, stairways, and walkways shall be kept reasonably clear and in good repair. CCR Title 8, 3272(c)

21. Secure ladders to prevent from falling. CCR. Title 8, 2940.6(d)





24. Replace missing cover on floor receptacle.



23. Mount display shelves to wall to prevent from falling.



25. The employer shall be responsible for the inspection, maintenance and testing of all portable fire extinguishers in the workplace. Portable extinguishers shall be visually inspected monthly. CCR Title 8, 6151(e)(2)



26. Exits shall be maintained free of all obstructions or impediments to full instant use in the case of fire or other emergency. CCR Title 8, 3225(1)



27. Bundle and constrain cords and cables to eliminate trip/fall hazard.



28. Organize and secure items stored overhead to prevent from falling.



29. Eyewash stations shall be maintained and free free of items which obstruct their use. CCR Title 8, 5162(c)



30. Maintain minimum 18-inch clearance between combustibles and ceiling. (with fire sprinklers) CCR Title 8, 6170(b)(10)



31. Replace missing cover on floor receptacle. Repair sloping floor.



32. Replace broken handle on fire extinguisher cabinet.

33. Secure items stored overhead to prevent from falling.




34. The employer shall be responsible for the inspection, maintenance and testing of all portable fire extinguishers in the workplace. Portable extinguishers shall be visually inspected monthly. CCR Title 8, 6151(e)(2)



35. Repair damaged bench.



36. Organize storage room. Potential trip hazard as well as excess combustibles.

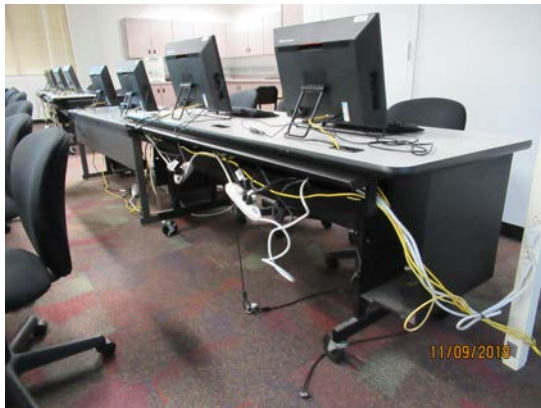

37. Bundle and constrain cords and cables under/around workstations.
Eliminate use of piggy-backed power strips and extension cords. NFPA Section 11.1.4



38. Provide emergency eyewash equipment.
Eyewash must deliver 0.4 gallons of flushing fluid per minute for at least 15 minutes. ANSI Z358.1



39. The employer shall provide portable fire extinguishers and shall mount, locate and identify them so that they are readily accessible to employees without subjecting the employees to possible injury. CCR Title 8, 6151(c)(1)



40. Remove accumulated waste materials. Provide process to control and maintain vegetation clearance requirements. CCR, Title 19. Section 304



41. Replace broken or stained ceiling tiles. Inspect for water leakage/roof damage.



42. Replace filters to maintain adequate ventilation.

43. Provide hazardous energy control procedures for control of energy sources. Establish a lockout/tagout program consisting of energy control procedures, employee training, and periodic inspections to ensure that, before any employee performs any servicing or maintenance on a machine or equipment where the unexpected energizing, start up, or release of stored energy could occur and cause injury, the machine or equipment is isolated from the energy source and rendered inoperative. CCR Title 8,2940.13






44. Store all flammables in flammables storage cabinet with secondary containment. Flammable or combustible liquids shall be stored in closed containers. CCR Title 8, 5545(a)




45. Provide mats with beveled edges to prevent trip and fall hazard.



46. Organize storage room. Potential trip hazard as well as excess combustibles.

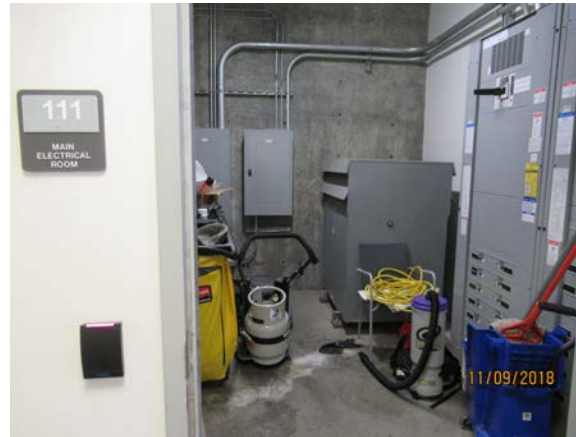

47. Maintain minimum 36-inch clearance in front of all electrical panels. NEC 110-26(A)(1). Repair damaged Electrical equipment.

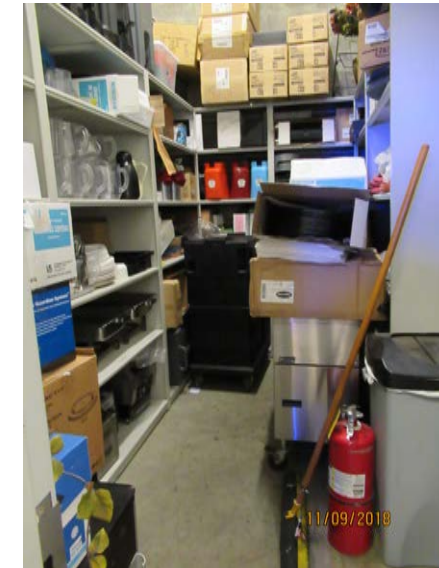

48. The employer shall provide portable fire extinguishers and shall mount, locate and identify them so that they are readily accessible to employees without subjecting the employees to possible injury. CCR Title 8, 6151(c)(1)



49. Remove flexible power cords used in place of permanent wiring. as a substitute for the fixed wiring of a structure. CCR Title 8, 2500(a)(1)

Bundle and constrain cords and cables under/around workstations.

Eliminate use of piggy-backed power strips and extension cords. NFPA Section 11.1.4



50. Organize and secure items stored overhead to prevent from falling.



51. Remove damaged classroom furniture.

Riverside Community College District

Safety Survey Recommendations – Status Report

Norco College

CSRM Safety Survey Date: November 9, 2018

ITEM	ROOM	RECOMMENDATION	STATUS (i.e. completed, in process)	ANTICIPATED COMPLETION DATE
1	M-1 - M-2	The employer shall provide portable fire extinguishers and shall mount, locate and identify them so that they are readily accessible to employees without subjecting the employees to possible injury. CCR Title 8, 6151(c)(1) The employer shall assure that portable fire extinguishers are maintained in a fully charged and operable condition and kept in their designated places at all times except during use. CCR Title 8, 6151(c)(4)		
2	M-1 - M-2	Store all flammables chemicals in flammables storage cabinet with secondary containment. Title 8, 5164(a)		
3	M-1 - M-2	Organize/remove excess storage - potential trip hazards as well as excess combustibles.		
4	M-1 - M-2	Exits shall be maintained free of all obstructions or impediments to full instant use in the case of fire or other emergency. CCR Title 8, 3225(1)		
5	M-1 - M-2	Provide proper storage procedures for hazardous waste/substances. CCR Title 8, 5164(a)(c)(d)		
6	M-1 - Bldg-1	The minimum space required in toilet compartments is provided so that a person using a wheelchair can maneuver into position at the water closet. This space cannot be obstructed. 11B-604.8.1.1		
7	M-1 - M-2	Remove accumulated waste materials. Potential trip hazards as well as excess combustibles. Provide process to control and maintain vegetation clearance requirements. CCR, Title 19. Section 304		
8	M-1 - M-2	Eyewash and drench shower stations must be installed in a well-lit area and identified with a highly visible safety sign. ANSI Z358.1		
9	M-1 - Bldg-2	Organize and secure shelves and items stored overhead to prevent from falling. Organize storage. Potential trip hazard as well as excess combustibles.		
10	M-1 - Bldg-2	Machinery and equipment designed for a fixed location shall be restrained so as to prevent walking or moving from its location. CCR Title 8, 3328(d) Secure ladders to prevent from falling. CCR. Title 8, 2940.6(d).		
11	M-1 - Bldg-2	Remove storage from on/around microwave ovens.		
12	M-1 - Bldg-2	Repair or secure opening to prevent the entrance or harborage of insects, rodents or other vermin. CCR Title 8, 3362(f)		
13	M-1 - Bldg-2	Pesticides, emptied containers, or equipment that holds or has held a pesticide, shall not be stored, handled, emptied, disposed of, or left unattended in such a manner or at any place where they may present a hazard to persons, animals (including bees), food, feed, crops or property. CCR Title 3, 6670		
14	M-1 - Bldg-2	Permanent aisles and walkways shall be kept reasonably clear and in good repair. CCR Title 8, 3272(c)		

15	M-1 - M-2	Store all flammables in flammables storage cabinet with secondary containment. Flammable or combustible liquids shall be stored in closed containers. CCR Title 8, 5545(a)		
16	M-1 - M-2	Trip Fall hazard. Replace drain cover/grate.		
17	M-1 - M-2	Remove accumulated waste materials. Potential trip hazards as well as excess combustibles. Provide process to control and maintain vegetation clearance requirements. CCR, Title 19. Section 304		
18	IT - 118	Provide emergency eyewash equipment. Eyewash must deliver 0.4 gallons of flushing fluid per minute for at least 15 minutes. ANSI Z358.1		
19	IT - 118	Mount fire extinguisher to wall. CCR Title 8, 6151(c)(1)		
20	IT - 118	Provide clearance around water heaters.		
21	IT - 120	Secure ladders to prevent from falling. CCR. Title 8, 2940.6(d)		
22	IT - 120	Organize and secure items stored overhead to prevent from falling. Organize storage. Potential trip hazard as well as excess combustibles. Permanent aisles, ladders, stairways, and walkways shall be kept reasonably clear and in good repair. CCR Title 8, 3272(c)		
23	IT - 123	Mount display shelves to wall to prevent from falling.		
24	IT - 123	Replace missing cover on floor receptacle.		
25	IT - 123	The employer shall be responsible for the inspection, maintenance and testing of all portable fire extinguishers in the workplace. Portable extinguishers shall be visually inspected monthly. CCR Title 8, 6151(e)(2)		
26	IT - 124	Exits shall be maintained free of all obstructions or impediments to full instant use in the case of fire or other emergency. CCR Title 8, 3225(1)		
27	IT - 124	Bundle and constrain cords and cables to eliminate trip/fall hazard.		
28	IT - 124	Organize and secure items stored overhead to prevent from falling.		
29	IT - 124	Eyewash stations shall be maintained and free of items which obstruct their use. CCR. Title 8, 5162(c)		
30	IT - 128	Maintain minimum 18-inch clearance between combustibles and ceiling. (with fire sprinklers) CCR Title 8, 6170(b)(10)		
31	IT - 111	Replace missing cover on floor receptacle. Repair sloping floor.		
32	ATEC - 101	Replace broken handle on fire extinguisher cabinet.		
33	ATEC - 101	Secure items stored overhead to prevent from falling.		
34	ATEC - 101	The employer shall be responsible for the inspection, maintenance and testing of all portable fire extinguishers in the workplace. Portable extinguishers shall be visually inspected monthly. CCR Title 8, 6151(e)(2)		
35	Outside 119	Repair damaged bench.		
36	ATEC - 119	Organize storage room. Potential trip hazard as well as excess combustibles.		
37	ATEC - 118	Bundle and constrain cords and cables under/around workstations. Eliminate use of piggy-backed power strips and extension cords. NFPA Section 11.1.4		
38	ATEC - 125	Provide emergency eyewash equipment. Eyewash must deliver 0.4 gallons of flushing fluid per minute for at least 15 minutes. ANSI Z358.1		

39	ATEC - 109	The employer shall provide portable fire extinguishers and shall mount, locate and identify them so that they are readily accessible to employees without subjecting the employees to possible injury. CCR Title 8, 6151(c)(1)		
40	Outside CACT	Remove accumulated waste materials. Provide process to control and maintain vegetation clearance requirements. CCR, Title 19. Section 304		
41	CACT	Replace broken or stained ceiling tiles. Inspect for water leakage/roof damage.		
42	CACT	Replace filters to maintain adequate ventilation.		
43	CACT	Provide hazardous energy control procedures for control of energy sources. Establish a lockout/tagout program consisting of energy control procedures, employee training, and periodic inspections to ensure that, before any employee performs any servicing or maintenance on a machine or equipment where the unexpected energizing, start up, or release of stored energy could occur and cause injury, the machine or equipment is isolated from the energy source and rendered inoperative. CCR Title 8,2940.13		
44	Outside CSS	Store all flammables in flammables storage cabinet with secondary containment. Flammable or combustible liquids shall be stored in closed containers. CCR Title 8, 5545(a)		
45	Cafeteria	Provide mats with beveled edges to prevent trip and fall hazard.		
46	CSS	Organize storage room. Potential trip hazard as well as excess combustibles.		
47	CSS - 111	Maintain minimum 36-inch clearance in front of all electrical panels. NEC 110-26(A)(1). Repair damaged Electrical equipment.		
48	CSS - 112	The employer shall provide portable fire extinguishers and shall mount, locate and identify them so that they are readily accessible to employees without subjecting the employees to possible injury. CCR Title 8, 6151(c)(1)		
49	CSS	Remove flexible power cords used in place of permanent wiring. as a substitute for the fixed wiring of a structure. CCR Title 8, 2500(a)(1) Bundle and constrain cords and cables under/around workstations. Eliminate use of piggy-backed power strips and extension cords. NFPA Section 11.1.4		
50	CSS	Organize and secure items stored overhead to prevent from falling.		
51	ATEC - 210	Remove damaged classroom furniture.		



Safety Assessment
December 7, 2018





1. Employer must evaluate the workplace to determine if any spaces are permit-required confined spaces. If the workplace contains permit spaces, the employer shall inform exposed employees and other employees performing work in the area, by posting danger signs or by any other equally effective means, of the existence, location of and the danger posed by the permit spaces. CCR Title 8, 5157(c)(1)(2)



2. Leakage or accumulation shall be corrected because of the potential for these conditions to cause the growth of mold. CCR Title 8, 3362(g)





3. Leakage or accumulation shall be corrected because of the potential for these conditions to cause the growth of mold. CCR Title 8, 3362(g)



5. The employer shall provide portable fire extinguishers and shall mount, locate and identify them so that they are readily accessible to employees without subjecting the employees to possible injury.
CCR Title 8, 6151(c)(1)



4. Secure displaced ceiling tile.


6. The employer shall assure that portable fire extinguishers are maintained in a fully charged and operable condition and kept in their designated places at all times except during use. CCR Title 8, 6151(c)(4)





7. Provide emergency eyewash equipment.
Eyewash must deliver 0.4 gallons of flushing fluid per minute for at least 15 minutes. ANSI Z358.1

8. The employer shall maintain copies of the required safety data sheets for each hazardous chemical in the workplace, and shall ensure that they are readily accessible during each work shift to employees when they are in their work area(s). CCR Title 8, 5194(g)(8)

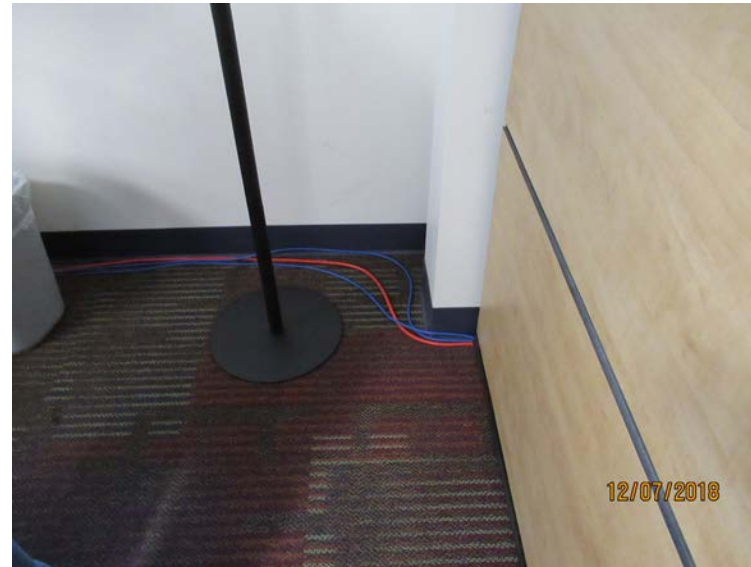

9. Remove flexible power cords used in place of permanent wiring. as a substitute for the fixed wiring of a structure. CCR Title 8, 2500(a)(1)



10. Bundle and constrain cords and cables under/around workstations.

Eliminate use of piggy-backed power strips and extension cords. NFPA Section 11.1.4



11. The employer shall be responsible for the inspection, maintenance and testing of all portable fire extinguishers in the workplace. Portable extinguishers shall be visually inspected monthly. CCR Title 8, 6151(e)(2)



12. Repair damaged stairs to prevent hazardous condition.

13. Appliances shall be connected directly to permanently installed receptacle. CFC 605.4-5



14. Replace stained ceiling tile. Leakage or accumulation shall be corrected because of the potential for these conditions to cause the growth of mold. CCR Title 8, 3362(g)

15. Organize storage. Maintain minimum 18-inch clearance between combustibles and ceiling. (with fire sprinklers) CCR Title 8, 6170(b)(10)





16. Provide appropriate covers to all exposed electrical/mechanical equipment. NEC (NFPA 70 110.27)



17. Bundle and constrain cords and cables under/around workstations. Eliminate use of piggy-backed power strips and extension cords. NFPA Section 11.1.4



18. Remove storage under exit stairways. Uniform Fire Code (UFC) Section 1210.1


19. The employer shall provide portable fire extinguishers and shall mount, locate and identify them so that they are readily accessible to employees without subjecting the employees to possible injury. CCR Title 8, 6151(c)(1)



20. Remove flexible power cords and power strips used in place of permanent wiring as a substitute for the fixed wiring of a structure. CCR Title 8, 2500(a)(1)



21. Provide appropriate covers to all exposed electrical/mechanical equipment. NEC (NFPA 70 110.27)

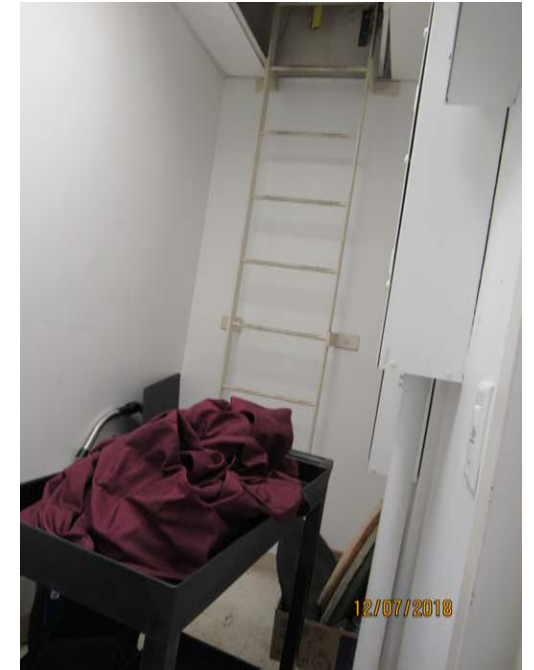

22. Remove storage from roof access ladders.



24. Replace broken face plate. Provide appropriate covers to all exposed electrical/mechanical equipment. NEC (NFPA 70 110.27)

23. Organize storage room. Potential trip hazard as well as excess combustibles.



25. Anchor storage shelves to wall.



27. Maintain minimum 36-inch clearance in front of all electrical panels. NEC (NFPA 70.110.26)

26. Remove obstructions from all fire alarms and warning strobes. NFPA 72, 3.3.121.2



28. Manual pull stations must be easily seen and readily available for use. The physical path to each one also must be kept clear of obstruction. NFPA 72, 5.13.5



29. Replace/repair water damaged exterior panels. Inspect for water leakage or interior damage. Leakage or accumulation shall be corrected because of the potential for these conditions to cause the growth of mold.
CCR Title 8, 3362(g)



Riverside Community College District

Safety Survey Recommendations – Status Report

Norco College

SCSRM Safety Survey Date: December 5, 2018

ITEM	ROOM	RECOMMENDATION	STATUS (i.e. completed, in process)	ANTICIPATED COMPLETION DATE
1	G118	Employer must evaluate the workplace to determine if any spaces are permit-required confined spaces. If the workplace contains permit spaces, the employer shall inform exposed employees and other employees performing work in the area, by posting danger signs or by any other equally effective means, of the existence, location of and the danger posed by the permit spaces. CCR Title 8, 5157(c)(1)(2)		
2	G116	Leakage or accumulation shall be corrected because of the potential for these conditions to cause the growth of mold. CCR Title 8, 3362(g)		
3	G137	Leakage or accumulation shall be corrected because of the potential for these conditions to cause the growth of mold. CCR Title 8, 3362(g)		
4	G108	Secure displaced ceiling tile.		
5	G137	The employer shall provide portable fire extinguishers and shall mount, locate and identify them so that they are readily accessible to employees without subjecting the employees to possible injury. CCR Title 8, 6151(c)(1)		
6	G102 – All Campus Locations	The employer shall assure that portable fire extinguishers are maintained in a fully charged and operable condition and kept in their designated places at all times except during use. CCR Title 8, 6151(c)(4)		
7	G106	Provide emergency eyewash equipment. Eyewash must deliver 0.4 gallons of flushing fluid per minute for at least 15 minutes. ANSI Z358.1		
8	G106	The employer shall maintain copies of the required safety data sheets for each hazardous chemical in the workplace and shall ensure that they are readily accessible during each work shift to employees when they are in their work area(s). CCR Title 8, 5194(g)(8)		
9	LRC	Remove flexible power cords used in place of permanent wiring. as a substitute for the fixed wiring of a structure. CCR Title 8, 2500(a)(1)		
10	Assessment Center	Bundle and constrain cords and cables under/around workstations. Eliminate use of piggy-backed power strips and extension cords. NFPA Section 11.1.4		
11	Assessment Center	The employer shall be responsible for the inspection, maintenance and testing of all portable fire extinguishers in the workplace. Portable extinguishers shall be visually inspected monthly. CCR Title 8, 6151(e)(2)		
12	Library	Repair damaged stairs to prevent hazardous condition.		
13	Library	Appliances shall be connected directly to permanently installed receptacle. CFC 605.4-5		

14	Library 219	Replace stained ceiling tile. Leakage or accumulation shall be corrected because of the potential for these conditions to cause the growth of mold. CCR Title 8, 3362(g)		
15	Library 219	Organize storage. Maintain minimum 18-inch clearance between combustibles and ceiling. (with fire sprinklers) CCR Title 8, 6170(b)(10)		
16	E108 - E109	Provide appropriate covers to all exposed electrical/mechanical equipment. NEC (NFPA 70 110.27)		
17	E115	Bundle and constrain cords and cables under/around workstations. Eliminate use of piggy-backed power strips and extension cords. NFPA Section 11.1.4		
18	SSV111	Remove storage under exit stairways. Uniform Fire Code (UFC) Section 1210.1		
19	SSV212	The employer shall provide portable fire extinguishers and shall mount, locate and identify them so that they are readily accessible to employees without subjecting the employees to possible injury. CCR Title 8, 6151(c)(1)		
20	SSV212	Remove flexible power cords and power strips used in place of permanent wiring as a substitute for the fixed wiring of a structure. CCR Title 8, 2500(a)(1)		
21	SSV211	Provide appropriate covers to all exposed electrical/mechanical equipment. NEC (NFPA 70 110.27)		
22	SSV212	Remove storage from roof access ladders.		
23	Bookstore	Organize storage room. Potential trip hazard as well as excess combustibles.		
24	Bookstore	Replace broken face plate. Provide appropriate covers to all exposed electrical/mechanical equipment. NEC (NFPA 70 110.27)		
25	Bookstore	Anchor storage shelves to wall.		
26	Bookstore	Remove obstructions from all fire alarms and warning strobes. NFPA 72, 3.3.121.2		
27	Bookstore	Maintain minimum 36-inch clearance in front of all electrical panels. NEC (NFPA 70.110.26)		
28	Bookstore	Manual pull stations must be easily seen and readily available for use. The physical path to each one also must be kept clear of obstruction. NFPA 72, 5.13.5		
29	Portable Buildings Faculty Offices	Replace/repair water damaged exterior panels. Inspect for water leakage or interior damage. Leakage or accumulation shall be corrected because of the potential for these conditions to cause the growth of mold. CCR Title 8, 3362(g)		